PROPOSED SEWAGE SYSTEM
FOR
GOODWIN BUILDERS INC.

HAMPTON FALLS. N. H.
SCALE 1"= 40' JAN. 1970
PARKER SURVEY ASSOC. INC
SEABROOK, N.H

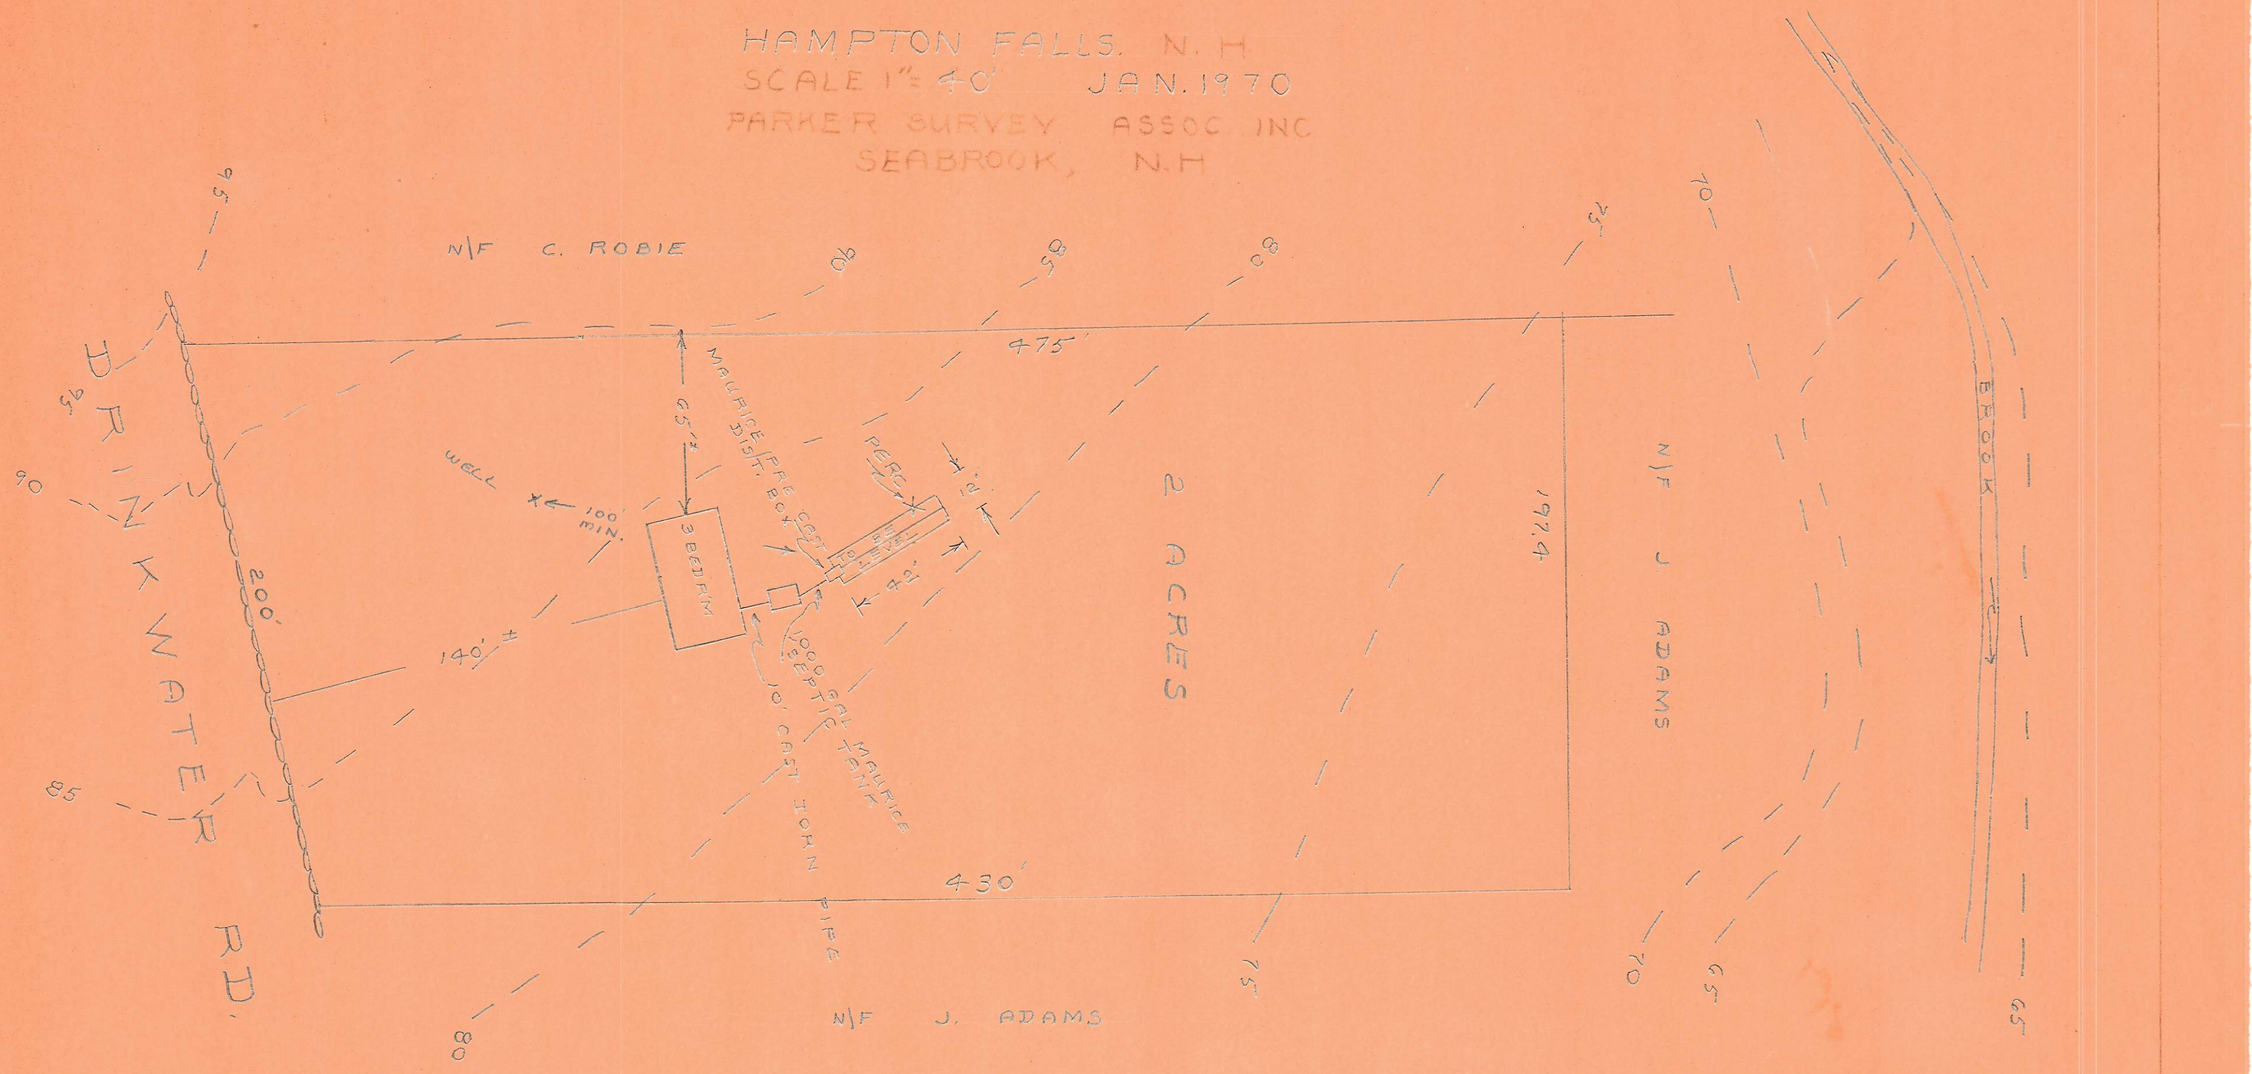

TEST PIT & SOIL LOG

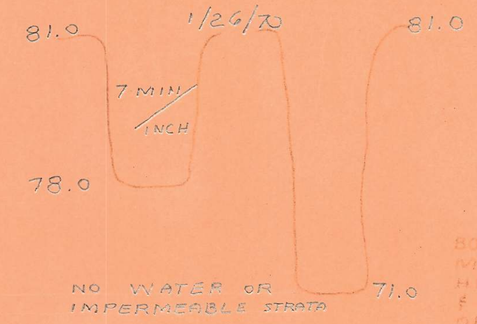

BOTTOM OF LEACHING AREA MIN. OF 4 FT. ABOVE HIGH WATER TABLE & 8 FT. CLAY, HARDPAN OR LEDGE

PARTIAL SECTION OF LEACHING BED

STONE SHALL BE WASHED CRUSHED STONE OR WASHED GRAVEL FREE FROM IRON, FINES, DUST & ORGANIC MATTER AS LAID